


Sc.5. Accident tip BLEVE la o cisternă auto

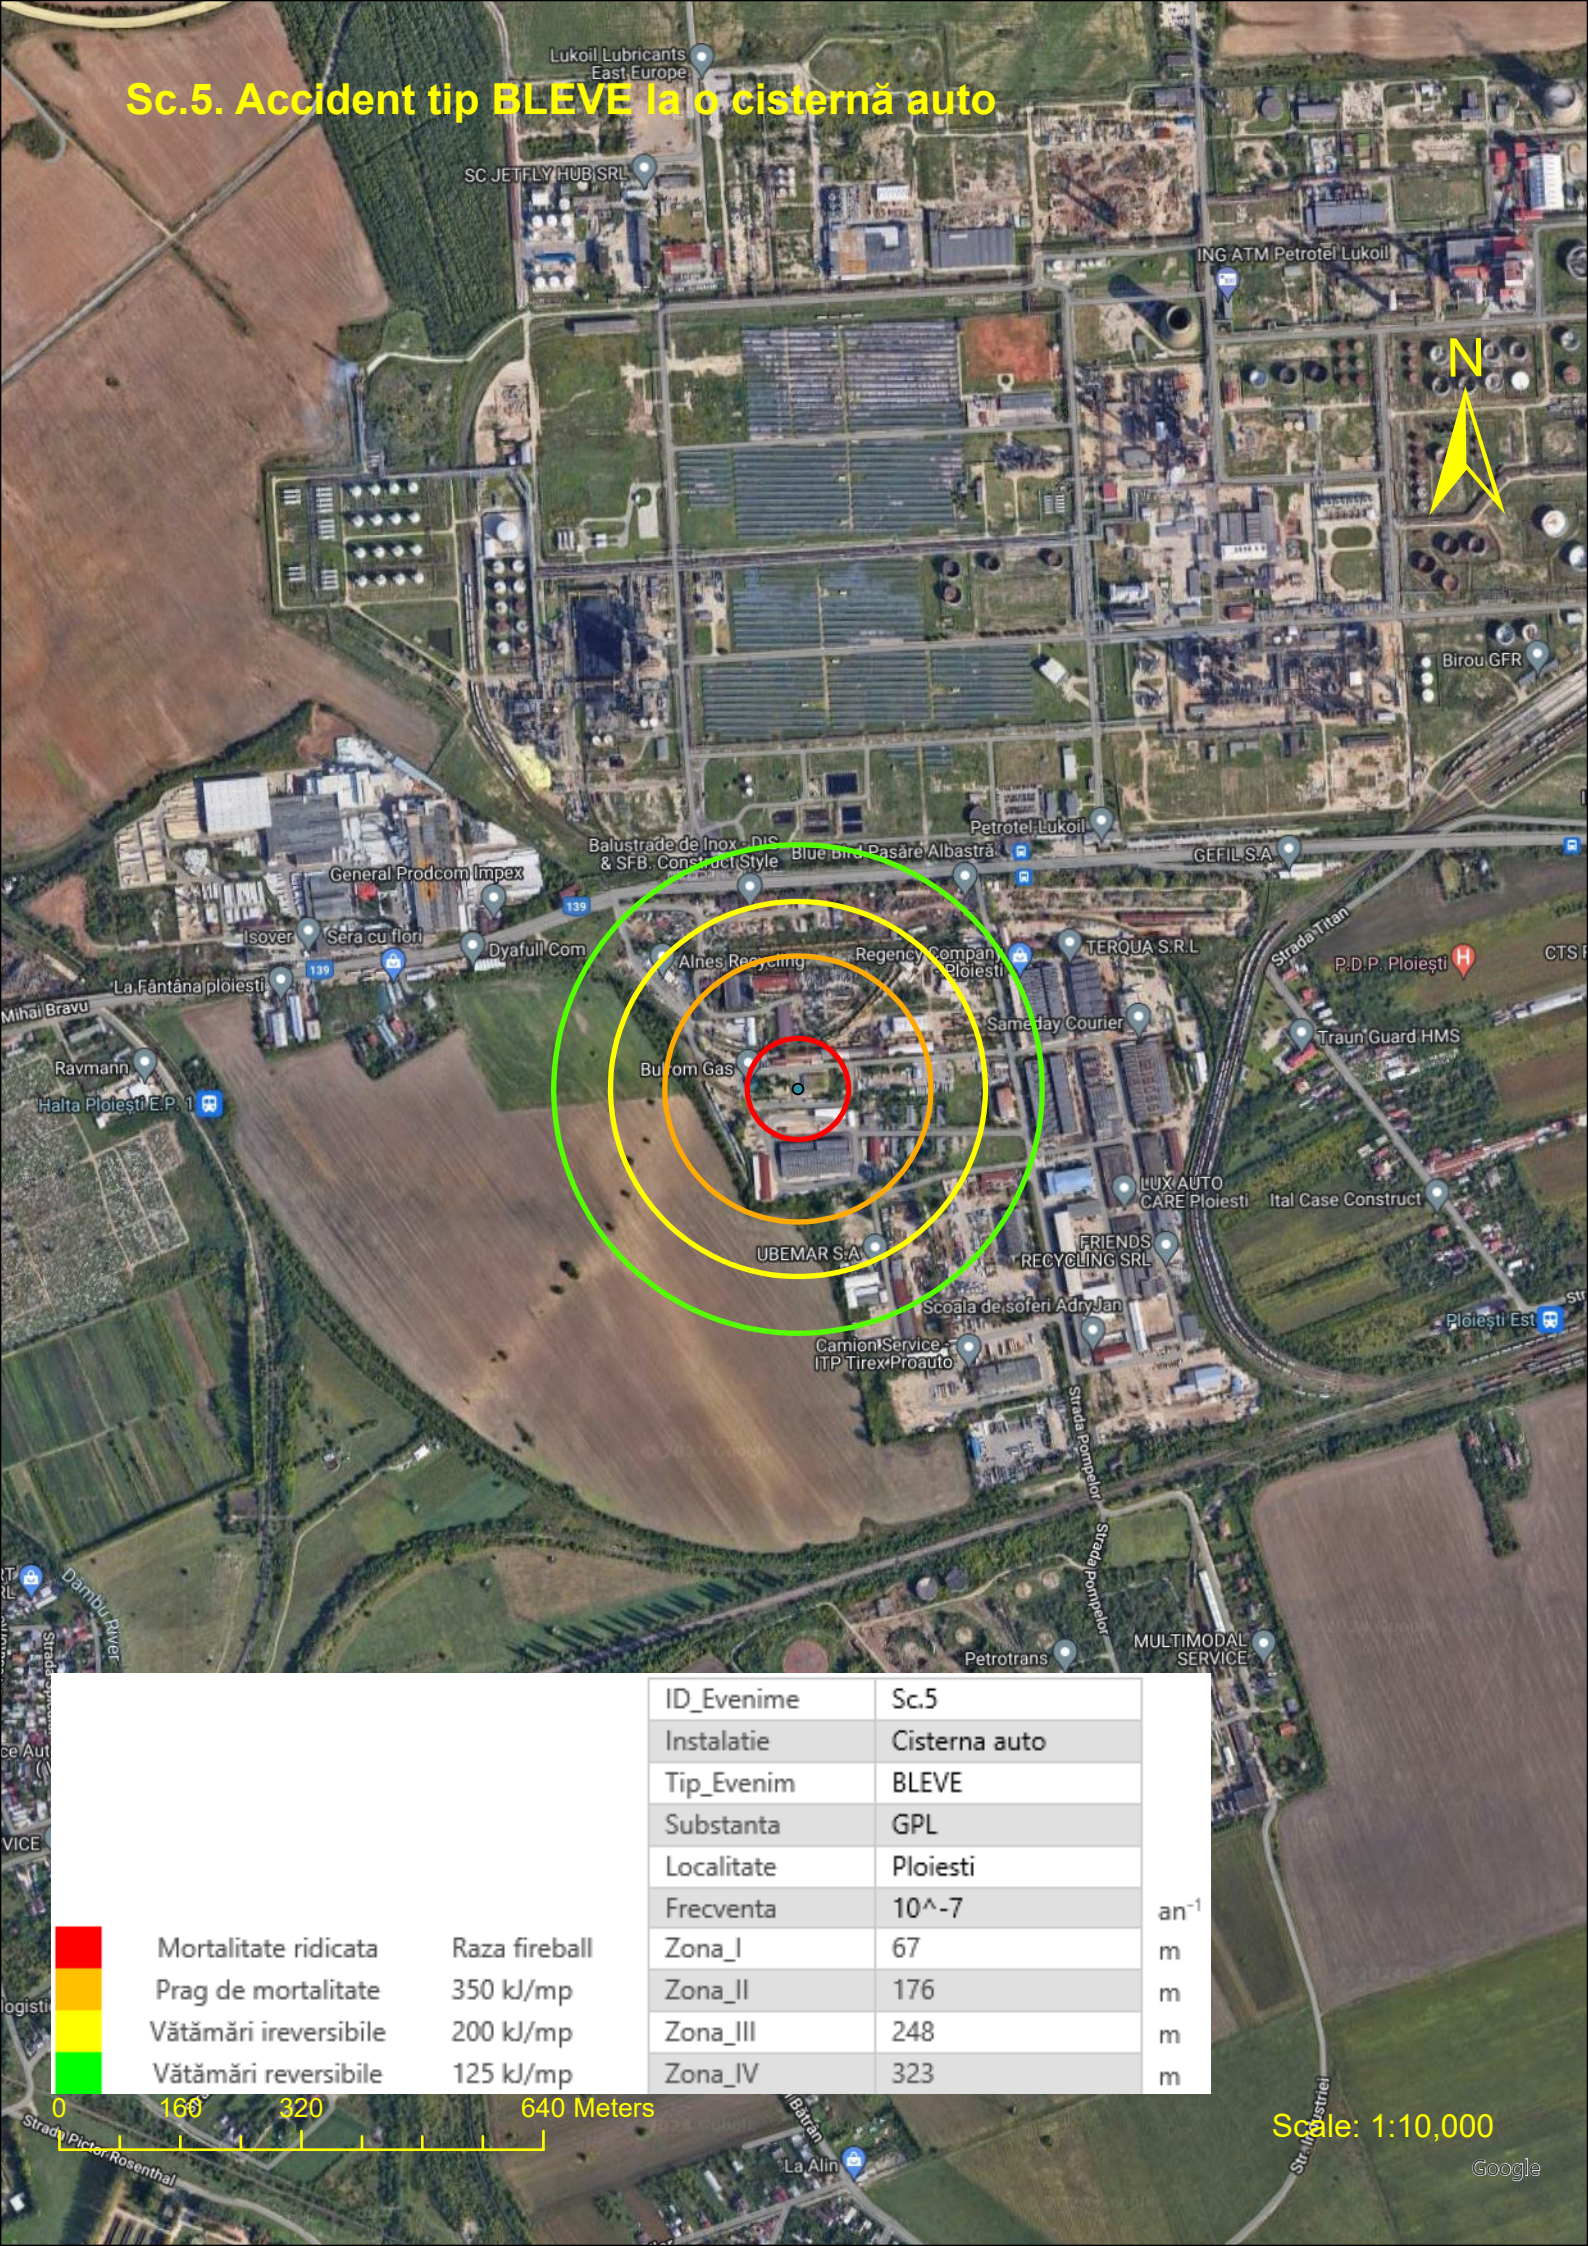

	Mortalitate ridicata	Raza fireball
	Prag de mortalitate	350 kJ/mp
	Vătmări ireversibile	200 kJ/mp
	Vătmări reversibile	125 kJ/mp

ID_Evenime	Sc.5
Instalatie	Cisterna auto
Tip_Evenim	BLEVE
Substanta	GPL
Localitate	Ploiesti
Frecventa	10^-7
Zona_I	67
Zona_II	176
Zona_III	248
Zona_IV	323

an⁻¹
m
m
m
m

Scale: 1:10,000