


Sc.6: Scurgeri minore (fisura d=1 cm) la rezervorul GPL skid\_FlashFire



			ID_Eveniment	Sc.6	an <sup>-1</sup>
			Instalatie	Skid GPL	
			Tip_Evenim	FlashFire	
			Substanta	GPL	
			Localitate	Ploiesti	
			Frecventa	4*10 <sup>-5</sup>	
			Zona_I	11	
<div><div></div><div></div><div></div><div></div></div>	Mortalitate ridicata	LEL	Zona_II	20	m
	Prag de mortalitate	50 % LEL	Zona_III	50	m
	Vătămări ireversibile	10 % LEL	Zona_IV	75	m
	Vătămări reversibile	5 % LEL			

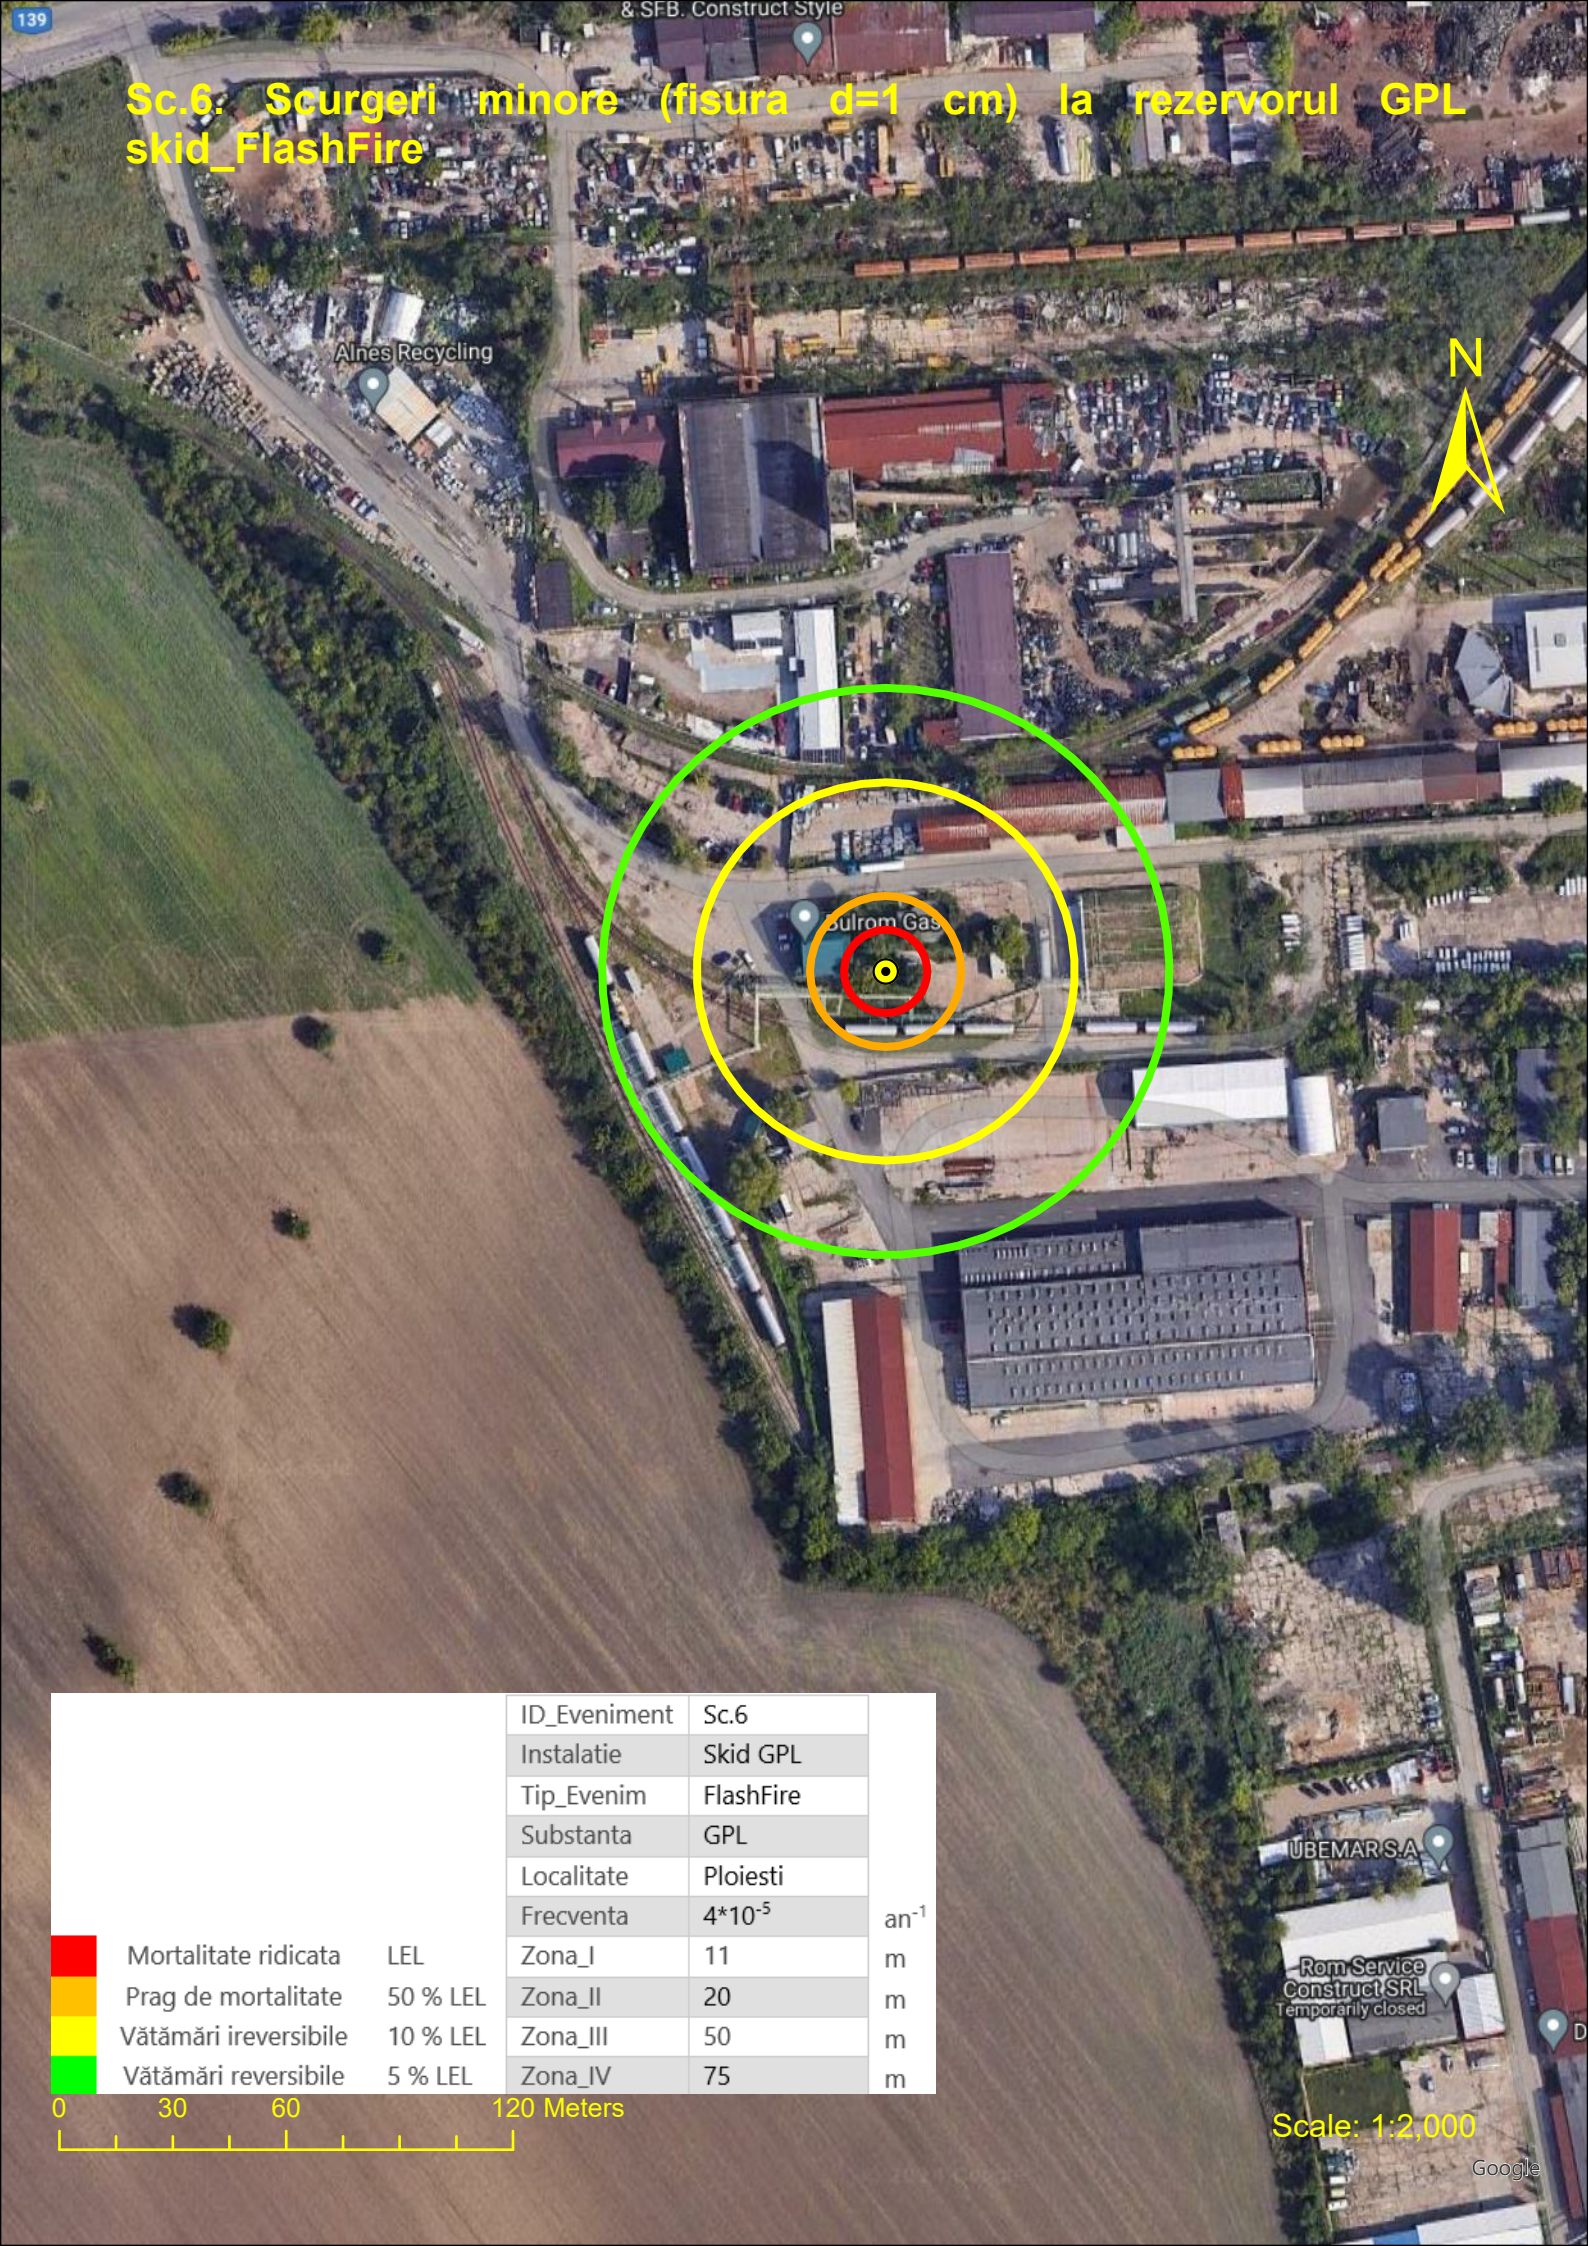

UBEMARSA

Rom Service  
Construct SRL  
Temporarily closed

Scale: 1:2,000